

Received February 8, 2017, accepted March 6, 2017, date of publication March 31, 2017, date of current version April 24, 2017.

Digital Object Identifier 10.1109/ACCESS.2017.2682260

Impact of High PV Penetration on the Inter-Area Oscillations in the U.S. Eastern Interconnection

SHUTANG YOU¹, (Student Member, IEEE), GEFEI KOU², (Member, IEEE),
YONG LIU¹, (Member, IEEE), XUEMENG ZHANG¹, (Student Member, IEEE),
YI CUI¹, (Member, IEEE), MICAH J. TILL¹, (Student Member, IEEE),
WENXUAN YAO¹, (Student Member, IEEE), AND YILU LIU^{1,3}, (Fellow, IEEE)

¹The University of Tennessee, Knoxville, TN 37996 USA

²Dominion Virginia Power, Richmond, VA 23220 USA

³Oak Ridge National Laboratory, Oak Ridge, TN 37830 USA

Corresponding author: Y. Liu (yliu66@utk.edu)

This work was supported in part by the U.S. Department of Energy SunShot National Laboratory Multiyear Partnership under Award 30844, in part by the Engineering Research Center Program of the National Science Foundation and DOE under Award NSF EEC-1041877, and in part by the CURENT Industry Partnership Program.

ABSTRACT This study explores the impact of high-photovoltaic (PV) penetration on the inter-area oscillation modes of large-scale power grids. A series of dynamic models with various PV penetration levels are developed based on a detailed model representing the U.S. Eastern Interconnection (EI). Transient simulations are performed to investigate the change of inter-area oscillation modes with PV penetration. The impact of PV control strategies and parameter settings on inter-area oscillations is studied. This paper finds that as PV increases, the damping of the dominant oscillation mode decreases monotonically. It is also observed that the mode shape varies with the PV control strategy and new oscillation modes may emerge under inappropriate parameter settings in PV plant controls.

INDEX TERMS Large-scale power system oscillation, photovoltaic (PV), oscillation mode, oscillation frequency, inertia.

I. INTRODUCTION

Solar photovoltaic (PV) generation grows quickly in the U.S. and worldwide, joining wind power as a major renewable energy technology. While many aspects of wind power's impact on system power grid stability has been investigated, including rotor angle stability [1]–[3], voltage stability [4], frequency response [5]–[7], and inter-area oscillations [1], [8]–[11], the impact of PV generation on power system dynamics has not been given enough attention.

Among all these aspects, inter-area oscillations need special attention from system operators. Poorly damped inter-area oscillations can reduce transmission line capacity, damage system generation and transmission facilities, influence power quality, and lead to cascading failures or blackouts. The impact of PV generation on power system oscillations may be attributed to various aspects. However, the findings of existing literature are not consistent. For example, the New-England and New York test system was used to investigate the PV's impact on its established inter-area oscillation mode; it was found that PV could detrimentally affect the inter-area

oscillation mode as PV integration results in larger angular separation among synchronous generators [12]. Furthermore, using small signal analysis and transient simulation, the study in [13] indicated that the increase of utility-scale and residential rooftop PV may decrease damping of inter-area oscillation modes due to reduced system inertia. However, other studies have found it is also possible that PV integration could improve small-signal stability. For example, the study in [14] concluded that PV could increase oscillation damping because PV adds damping to critical modes, and the scattered integration pattern is more beneficial than the concentrated pattern. Other studies that have similar findings include [15] and [16]. Additionally, other literature observed both beneficial and detrimental influence of PV on oscillations. Reference [17] studied the impact of increased PV on system small signal stability based on a single-machine infinite-bus system. It was found that PV could either have positive or negative impact on oscillation damping. Similar findings can be found in [11] and [18]. The operation limit of PV also plays a significant role on the contribution of PV's damping torque.

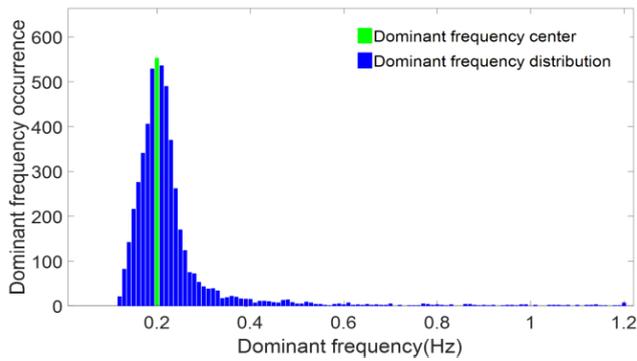


FIGURE 1. Dominant frequency distribution of inter-area oscillations.

Reference [19] studied the impact of distributed PV and large PV farms on system stability and found that damping does not vary significantly with the increase of either PV type.

Obviously, the impact of PV on power system inter-area oscillations is not yet well understood. Since there are so many factors that may play a role in this phenomenon, the impact of PV on inter-area oscillations may need to be studied on a case-by-case basis at this stage. Therefore, the United States Eastern Interconnection (EI) is used as a case study in this paper to investigate the impact of PV generation on a large interconnected power grid. Specifically, by incrementally displacing synchronous generators with PV in the EI dynamic model, how the dynamics of PV affect inter-area oscillation frequency and damping ratio will be illustrated. The following sections present the procedures and details in model development, time-domain dynamic simulation, and analytical analysis.

II. CURRENT OSCILLATION MODE ANALYSIS IN THE EI

Since the EI covers a wide area, inter-area oscillation is an important issue for system operators and planners [20], [21]. Our previous study shows that the inter-area oscillation modes are observable by FNET/GridEye, which is a wide-area measurement system deployed at the distribution level [22], [23]. Before analyzing the impact of PV on oscillations of the U.S. EI, this section analyzes the characteristics of inter-area oscillations in the EI based on FNET/GridEye wide-area measurements during 2013 to 2015 using the Matrix-Pencil method [24]. Fig. 1 shows the frequency distribution of the dominant oscillation modes, while Fig. 2 shows the distribution of the damping ratio of the same. It can be seen that the frequency of the dominant oscillation of the EI is around 0.2 Hz and the center of the damping ratio is close to 10%. Additionally, both distributions show patterns with long tails, similar to the Beta distribution. The slight shifting of oscillation frequency and damping can be explained by seasonal and daily load variations.

Table 1 shows the oscillation frequency and damping ratio of different years. It can be seen that the oscillation characteristics are relatively stable in past years. The frequency center changed slightly from 2014 to 2015 (0.21 Hz to 0.20 Hz). This can be explained by the increase of renewable generation in

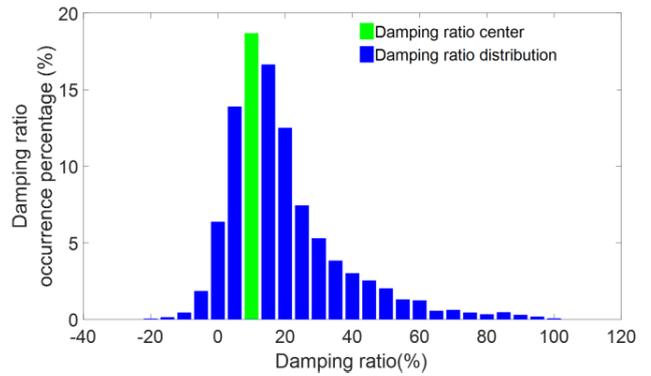


FIGURE 2. Damping ratio distribution of inter-area oscillations.

TABLE 1. Oscillation frequency and damping ratio.

Year	2013	2014	2015
Dominant frequency center (Hz)	0.21	0.21	0.20
Damping ratio center of the dominant frequency (%)	10	10	10

the EI. Since 0.2 Hz is the dominant oscillation mode in the EI, this mode will be the study focus in the rest of this paper.

III. EI MODELLING APPROACH FOR HIGH PV

High PV penetration. model development, time-domain transient simulation, and oscillation analysis are conducted to investigate the change of the 0.2 Hz oscillation mode with the increase of PV. In this section, high PV penetration model development is introduced.

A. BASE MODEL INTRODUCTION

This study is based on the detailed power flow scenario for the EI in year 2030, which was originally developed by the Eastern Interconnection Planning Collaborative (EIPC) [25]. This power flow model depicts a scenario in which wind generation provides 15% instantaneous power and some transmission network upgrades are built to facilitate wind power transfer, primarily from west to east within the EI. Earlier efforts also include the development of corresponding dynamic models, including synchronous generators, excitation systems, turbine governors, and dynamic load models. Extensive sanity checks and contingency simulations are conducted to represent the actual detailed dynamics of existing components, as well as ensuring numerical convergence and simulation accuracy. More detailed information on this dynamic modeling effort can be found in [26]. Some statistic values on this model are shown in Table 2.

B. HIGH PV PENETRATION MODEL DEVELOPMENT

Before developing the high PV power system models, this study must define the PV penetration rates for the to-be-developed high PV simulation scenarios. Based on the results of a survey involving electric utilities, national labs and research institutes, the renewable generation mix of the

TABLE 2. Basic information of the EI model.

EI model statistics	Value
Total bus number	68309
Generator number	8337
Branch number	58784
Load	560 GW

TABLE 3. PV and Wind penetration rates for all EI scenarios.

Scenario	Instantaneous PV penetration level
Scenario 1	5%
Scenario 2	25%
Scenario 3	45%
Scenario 4	65%

TABLE 4. PLEXOS model input data sources.

PLEXOS model input	Data sources
Existing generation and transmission infrastructure	The Eastern Interconnection Planning Collaborative (EIPC) dataset ² [28, 30-32]
Load forecast	
Solar radiation	
Fuel price forecast	
Carbon emission price forecast	
PV price forecast	North American PV Outlook [33]
PV siting land price	Land Value 2015 Summary [34]


to-be-developed high PV simulation scenarios are defined as 5%, 25%, 45%, and 65% PV penetration (as shown in Table 3), plus 15% wind at the interconnection level [27]. The rest is conventional generation including hydro, nuclear, and thermal power plants.

The development of high PV penetration models includes two major steps: 1) Generate PV distribution. 2) Incorporate the dynamic models of PV and wind into the system model.

In the first step, the guideline for PV plant siting is to optimize the distribution of PV based on various impact factors, including existing generation and transmission infrastructure, load forecasts, solar radiation, fuel price forecasts, carbon emission, PV price forecasts, PV site land price, etc. The horizon of this PV projection features a PV growth primarily driven by a high carbon-emission price curve as predicted in [28]. A summary of the sources of input data in the PLEXOS optimization model¹ is shown in Table 4 [29]. Using these parameters as inputs, a PV projection model is applied to optimize the PV distribution to minimize the total cost in the projected high PV scenarios.

¹PLEXOS uses a bubble/pipe model representing 24 partitioned regions in the EI and the interfaces between them. These regions represent utilities, regional transmission operators, coordinating authorities, independent system operators, and other natural groupings based on the structure of the EI.

²The EIPC dataset is the main dataset used for optimization. This dataset was created by Charles River Associates (CRA) in an effort supported by the U.S. Department of Energy involving major stakeholders and planning coordinators in the Eastern Interconnection. Energy Exemplar translated this dataset into PLEXOS for multiple EI expansion studies

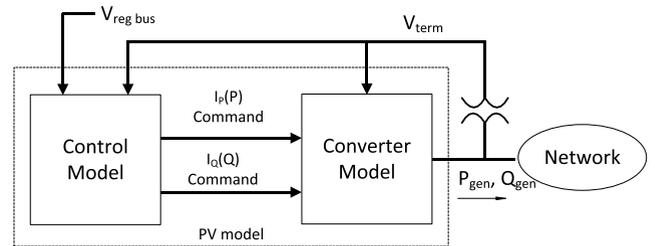**FIGURE 3.** PV dynamic model connectivity.**TABLE 5.** PV plants control strategies [35].

PV control strategies	Description
Strategy 1: Volt/Var control with SolarControl ³	Current configuration of North American PV plants
Strategy 2: Volt/Var control without SolarControl	SolarControl turned off and a slow reset of reactive power

The optimization problem is solved by a commercial mixed-integer programming solver (Xpress-XP). The optimized result is the projected PV capacity distribution in each region for each PV penetration level.

Fig. 4 shows the PV distributions for the four renewable penetration levels. Following the PV distribution optimization, the second step is to incorporate PV dynamic models into each scenario. The connectivity diagram of the PV dynamic model is shown in Fig. 3. Details about the converter and control models of a PV power plant can be found in [35]. In this step, the distribution of PV is kept consistent with the PV siting optimization result. Since these are future scenarios, generic dynamic parameters of PV power plants are adopted for the models [35]. Table 5 shows the two typical control strategies for PV power plants in North America [36]. As the normal configuration, the Volt/Var control with SolarControl (Strategy 1) is selected as the base strategy.

IV. IMPACT OF HIGH PV ON EI OSCILLATION MODES

The EI is a geographically dispersed power grid. To capture its inter-area oscillation modes, multiple observation locations across the EI are necessary to mitigate the impact of local oscillations and obtain more reliable results from inter-area oscillation analysis. The observation locations in this study are shown in Fig. 5. To analyze the oscillations observed at each observation point, the Matrix Pencil method is applied to the bus frequency at each location [37]. The oscillation analysis results from all observation locations are combined to form a more complete picture of oscillation trends. These procedures are conducted under four scenarios, specifically 5%, 25%, 45%, and 65% PV penetration.

A. IMPACT ON FREQUENCY AND DAMPING RATIOS

To observe oscillations, a test disturbance is applied to the system and the frequency response is recorded at multi-

³The SolarControl function monitors a specified bus voltage and compares it to a reference voltage.

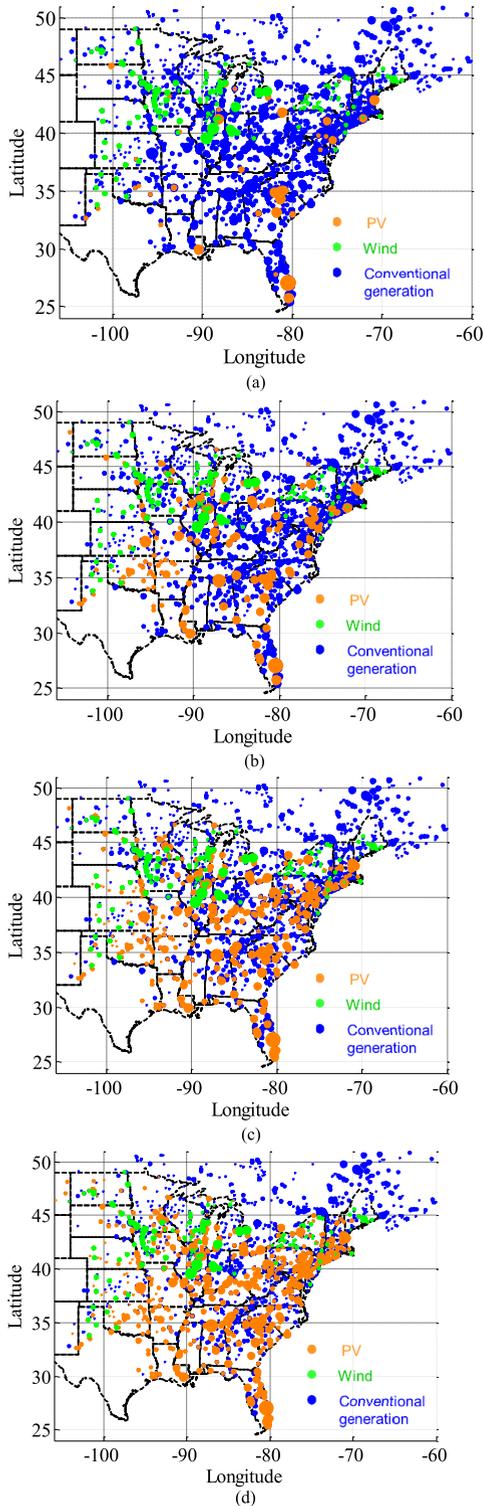


FIGURE 4. PV distribution in different scenarios. (a) 5%PV + 15%WT. (b) 25% PV + 15%WT. (c) 45%PV + 15%WT. (d) 65%PV + 15%WT.

ple locations. This disturbance is a three-phase fault on a 500 kV bus located in the central EI lasting for two cycles. Using Matrix Pencil analysis to analyze the oscillation modes at multiple locations, the frequency and damping ratios of the 0.2 Hz inter-area oscillation mode at each observation

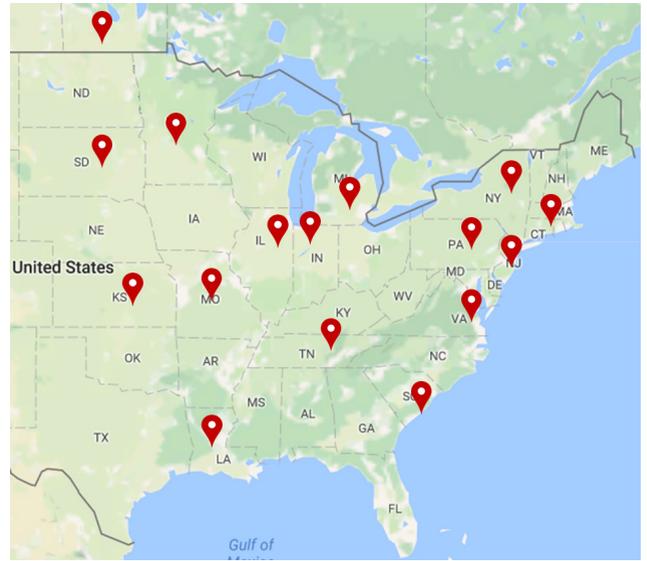


FIGURE 5. Observation locations in the U.S. EI.

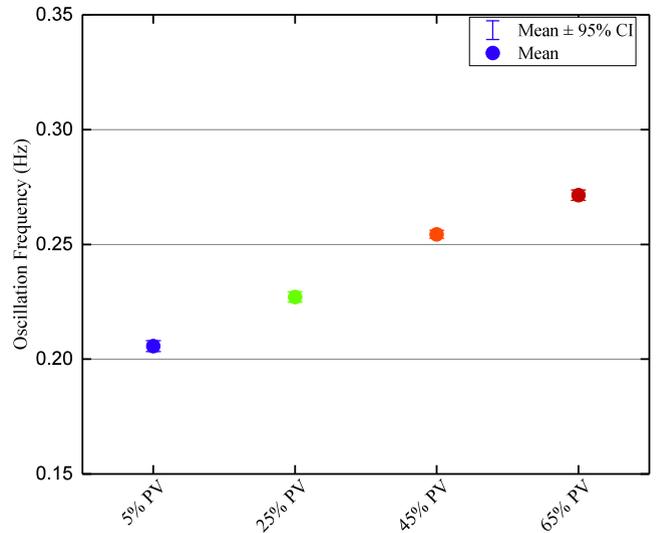


FIGURE 6. Oscillation frequency change as PV penetration increases.

location are calculated. The change of oscillation frequency and damping ratios with PV penetration are shown in Fig. 6 and Fig. 7, respectively. It can be noted that as PV penetration increases from 5% to 65%, the oscillation frequency increases almost linearly from 0.20 Hz to 0.28 Hz, and the damping ratio decreases from around 9% to 6%. The distribution of the damping ratio Fig. 8 and Fig. 9 shows the frequency profiles of two different locations: Connecticut (CT) and Tennessee (TN), respectively. It can be seen from Fig. 8 that the oscillation frequency increases, but the amplitude and damping decreases as PV penetration increases. In TN (Fig. 9), while the change of this inter-area oscillation mode is similar to that of Connecticut, there is an obvious local oscillation as well due to the proximity of the disturbance location. The frequency of this local oscillation is around 15 Hz for the 65% PV penetration scenario. It can be noted

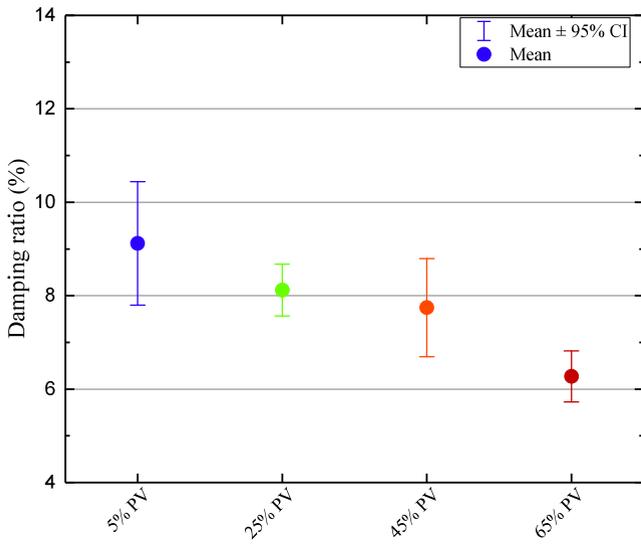


FIGURE 7. Oscillation damping ratio change as PV penetration increases.

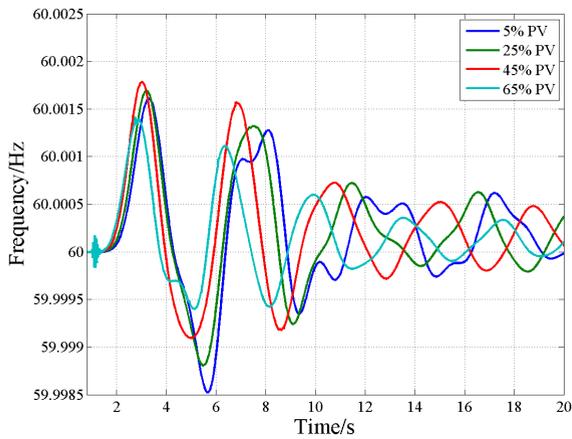


FIGURE 8. Oscillation frequency change as PV penetration increases (CT).

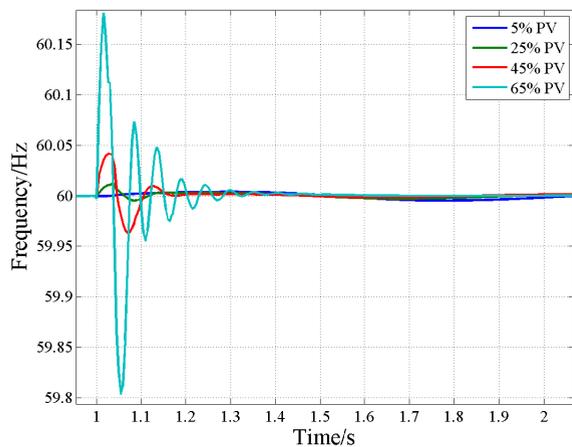


FIGURE 9. Local oscillation changes as PV penetration increases (TN).

that this oscillation frequency increases with PV penetration, indicating that this oscillation mode change is related to the reduction of system inertia.

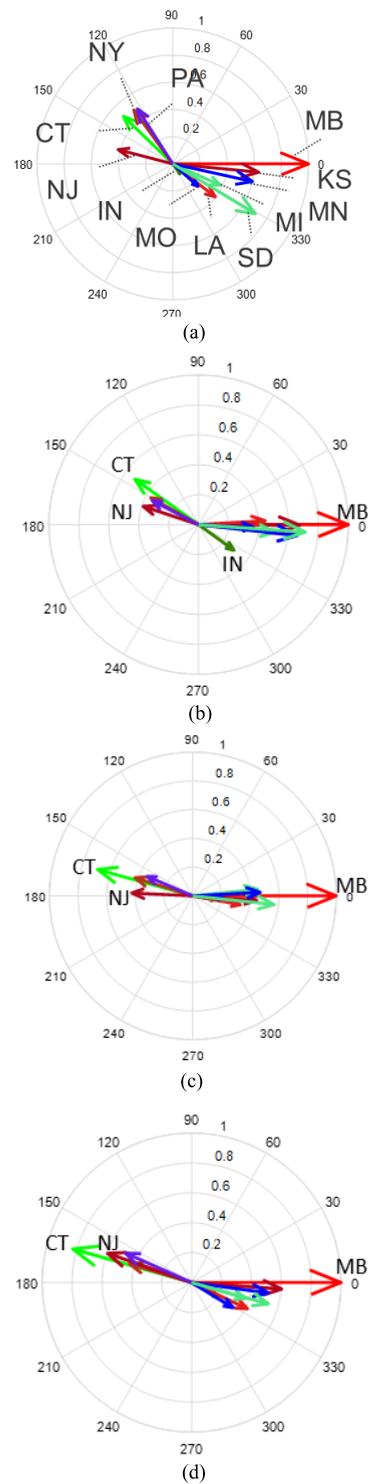


FIGURE 10. Mode shape change with PV penetration. (a) 5% PV. (b) 25% PV. (c) 45% PV. (d) 65% PV.

B. IMPACT ON MODE SHAPE

The mode shape describes the angular information of an oscillation mode and can be used to design additional damping controls. Fig. 10 shows the oscillation mode under different PV penetration levels. It can be seen that the 0.2 Hz inter-area oscillation mode has two main coherent groups:

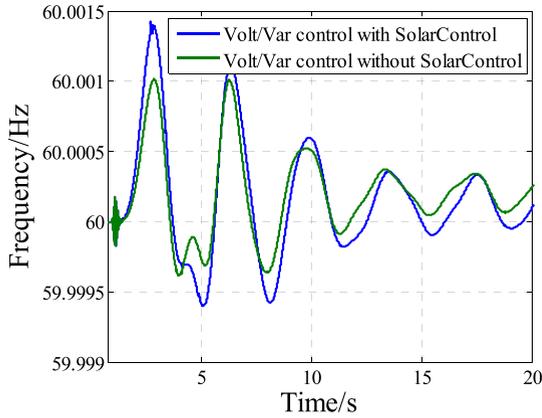


FIGURE 11. Oscillation frequency in CT under different PV power plant control strategies (65% PV).

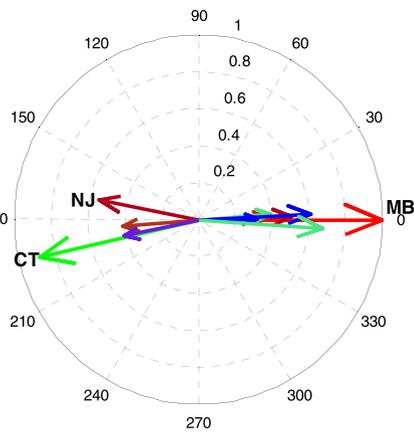



FIGURE 12. Oscillation mode shape at 65% PV (Control Strategy 2).

Northeastern EI (NY, PA, CT, and NJ, etc.) and Western EI (MB, MN, and KS, etc). As PV penetration increases, the angular difference between buses within each group decreases, indicating the increase of coherence between generators within each group due to the decrease of conventional generation.


C. IMPACT OF PV PLANT CONTROL STRATEGIES ON INTER-AREA OSCILLATIONS

The control strategies of PV power plants impact inter-area oscillation modes. For a comparison with Control Strategy 1, Control Strategy 2 (Volt/Var control without SolarControl) is applied to all PV plants. Fig. 11 contrasts the frequency profile of a bus in CT under both control strategies in the 65% penetration scenario. It can be seen that the system oscillation frequencies under the two control strategies are close, but Control Strategy 2 has a smaller oscillation amplitude and damping ratio, due to the slower reset of reactive power from PV plants after the disturbance.

Fig. 12 shows the oscillation mode shape under Control Strategy 2. It can be seen that the oscillation mode shape also includes two separate groups, similar to Control Strategy 1 (Fig. 10 (d)). but with some differences in phase angles, especially at grid edges such as New Jersey and Manitoba,

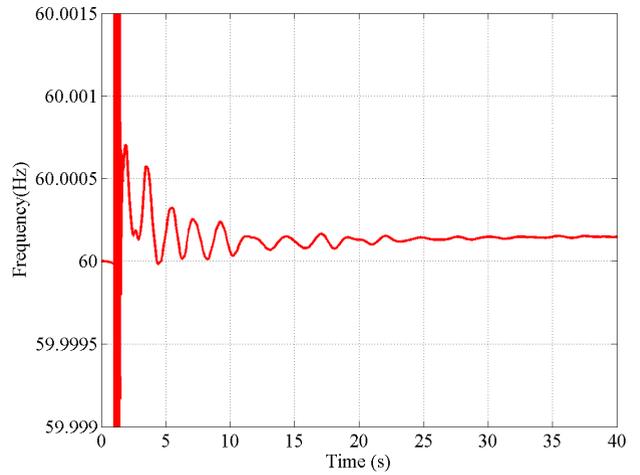

(a)

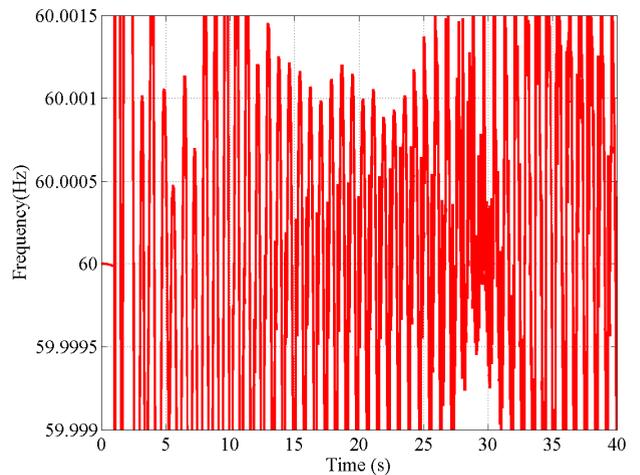

(b)

FIGURE 13. Frequency profile at IL under different PV control parameter settings (65% PV). (a) Control Strategy 1 (Volt/Var control with SolarControl). (b) Control Strategy 1 with fast power factor control.

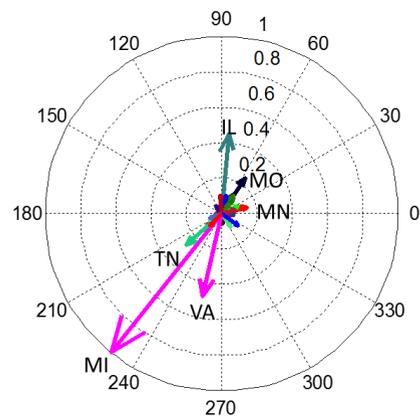


FIGURE 14. Mode shape of the 1.2 Hz Inter-area mode (65% PV).

Canada. This oscillation mode shape difference is due to the discrepancy in reactive power output under the two PV control strategies.

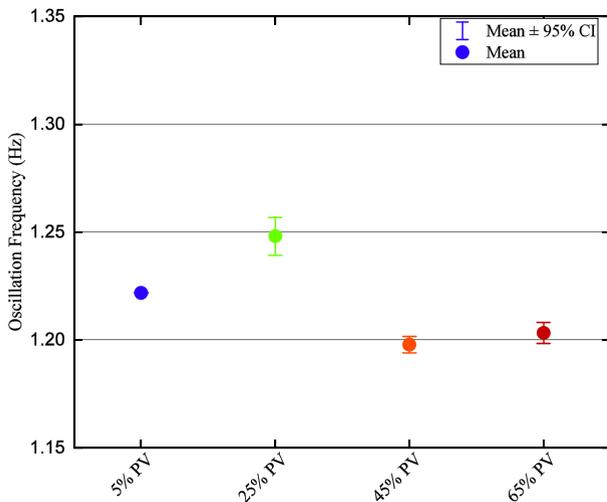


FIGURE 15. Oscillation frequency change with PV penetration (1.2 Hz mode).

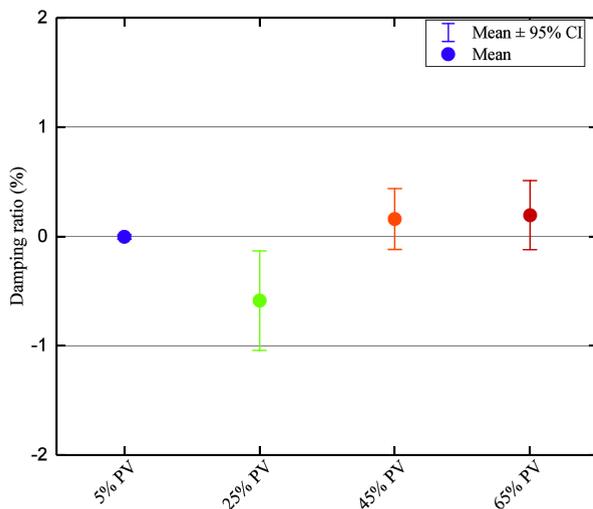


FIGURE 16. Damping ratio change with PV penetration (1.2 Hz mode).

D. INTRODUCTION OF NEW INTER-AREA OSCILLATION MODES UNDER CERTAIN PV PLANT CONTROL SETTINGS

Certain control parameters can introduce new oscillation modes. The initial reactive power regulator gain value is increased from 0.1 to 0.5 in Control Strategy 1. Applying the same disturbance as before, the frequency profiles at a 138 kV bus in Illinois (IL) for the 65% PV scenario under the two different settings are shown in Fig. 13. A 1.2 Hz inter-area oscillation mode can be easily seen after the disturbance for the case with a higher reactive power gain. Fig. 14 shows the mode shape of the 1.2 Hz oscillation mode. It can be noted that large oscillation locations include MI, IL, and VA.

Fig. 15 and Fig. 16 show the changes in frequency and damping ratios of this new oscillation mode for multiple PV penetration levels. Unlike the 0.2 Hz mode, the frequency and damping ratios of the 1.2 Hz mode barely change with PV penetration. This insensitivity is seen because the

PV controllers, which are not influenced by time constants related to system inertia, cause this oscillation mode.

V. CONCLUSIONS

Based on detailed dynamic system models, this paper studied the impact of high PV penetration on the inter-area oscillation modes of the U.S. EI. The analytical procedures include dynamic model development, PV plant siting, time-domain transient simulation, and Matrix Pencil analysis. Changes in oscillation frequencies, damping, and mode shapes, as well as the introduction of new oscillation modes, are studied by varying PV penetration levels, control strategies and parameters. It is found that oscillation damping decreases as PV penetration increases in the system, indicating that additional operation and planning consideration may be required to increase oscillation damping as PV penetration increases in the future. Variations in PV control strategies and parameters are found to impact mode shape and can create new oscillation modes. These results can help system operators and planners understand system oscillation behaviors and design mitigation methods for future high PV generation portfolios. The basic analysis procedures are generic and can be applied to other large-scale power systems.


ACKNOWLEDGMENT

The authors would like to thank G. Yuan, T. Golnas, and R. Hott, U.S. Department of Energy.

REFERENCES

- [1] G. Kou, Z. Pan, M. Till, Y. Liu, S. Hadley, and T. King, "Rotor angle stability and inter-area oscillation damping studies on the U.S. eastern interconnection (EI) under high wind conditions," in *Proc. Power Energy Soc. General Meeting (PESGM)*, Jul. 2016, pp. 1–5.
- [2] E. Vittal and M. O'Malley, and A. Keane, "Rotor angle stability with high penetrations of wind generation," *IEEE Trans. Power Syst.*, vol. 27, no. 1, pp. 353–362, Feb. 2012.
- [3] M. Edrah, K. L. Lo, and O. Anaya-Lara, "Impacts of high penetration of DFIG wind turbines on rotor angle stability of power systems," *IEEE Trans. Sustain. Energy*, vol. 6, no. 3, pp. 759–766, Jul. 2015.
- [4] E. Vittal and M. O'Malley, and A. Keane, "A steady-state voltage stability analysis of power systems with high penetrations of wind," *IEEE Trans. Power Syst.*, vol. 25, no. 1, pp. 433–442, Feb. 2010.
- [5] M. J. Till, Y. Liu, Y. Liu, M. Patel, and T. King, "Frequency response of the eastern interconnection due to increased wind generation," in *Proc. IEEE PES General Meeting Conf. Expo.*, Jul. 2014, pp. 1–5.
- [6] N. W. Miller, M. Shao, and R. D' Aquila, S. Pajic, and K. Clark, "Frequency response of the US eastern interconnection under conditions of high wind and solar generation," in *Proc. 7th Annu. IEEE Green Technol. Conf.*, Apr. 2015, pp. 21–28.
- [7] S. You, X. Zhang, L. Yong, Y. Su, Y. Liu, and S. W. Hadley, "Impact of high PV penetration on U.S. eastern interconnection frequency response," in *Proc. Power Energy Soc. General Meeting (PESGM)*, 2017, pp. 1–5.
- [8] Y. Liu, J. R. Gracia, T. J. King, and Y. Liu, "Frequency regulation and oscillation damping contributions of variable-speed wind generators in the U.S. eastern interconnection (EI)," *IEEE Trans. Sustain. Energy*, vol. 6, no. 3, pp. 951–958, Jul. 2015.
- [9] G. Tsourakis, B. M. Nomikos, and C. D. Vournas, "Contribution of doubly fed wind generators to oscillation damping," *IEEE Trans. Energy Convers.*, vol. 24, no. 3, pp. 783–791, Sep. 2009.
- [10] D. Gautam, V. Vittal, and T. Harbour, "Impact of increased penetration of DFIG-based wind turbine generators on transient and small signal stability of power systems," *IEEE Trans. Power Syst.*, vol. 24, no. 3, pp. 1426–1434, Aug. 2009.

- [11] J. Quintero, V. Vittal, G. T. Heydt, and H. Zhang, "The impact of increased penetration of converter control-based generators on power system modes of oscillation," *IEEE Trans. Power Syst.*, vol. 29, no. 5, pp. 2248–2256, Sep. 2014.
- [12] R. Shah, N. Mithulananthan, and R. C. Bansal, "Oscillatory stability analysis with high penetrations of large-scale photovoltaic generation," *Energy Convers. Manage.*, vol. 65, pp. 420–429, Jan. 2013.
- [13] S. Eftekharijad, V. Vittal, G. T. Heydt, B. Keel, and J. Loehr, "Small signal stability assessment of power systems with increased penetration of photovoltaic generation: A case study," *IEEE Trans. Sustain. Energy*, vol. 4, no. 4, pp. 960–967, Oct. 2013.
- [14] R. Shah, N. Mithulananthan, A. Sode-Yome, and K. Y. Lee, "Impact of large-scale PV penetration on power system oscillatory stability," in *Proc. IEEE PES General Meeting*, Jul. 2010, pp. 1–7.
- [15] B. Tamimi, C. Cañizares, and K. Bhattacharya, "Modeling and performance analysis of large solar photo-voltaic generation on voltage stability and inter-area oscillations," in *Proc. IEEE Power Energy Soc. General Meeting*, Jul. 2011, pp. 1–6.
- [16] R. Shah, N. Mithulananthan, and R. C. Bansal, "Damping performance analysis of battery energy storage system, ultracapacitor and shunt capacitor with large-scale photovoltaic plants," *Appl. Energy*, vol. 96, pp. 235–244, Aug. 2012.
- [17] W. Du, H. F. Wang, and R. Dunn, "Power system small-signal oscillation stability as affected by large-scale PV penetration," in *Proc. Int. Conf. Sustain. Power Generat. Supply*, Apr. 2009, pp. 1–6.
- [18] R. Elliott, R. Byrne, A. Ellis, and L. Grant, "Impact of increased photovoltaic generation on inter-area oscillations in the Western North American power system," in *Proc. IEEE PES General Meeting Conf. Expo.*, Jul. 2014, pp. 1–5.
- [19] B. Tamimi, C. Canizares, and K. Bhattacharya, "System stability impact of large-scale and distributed solar photovoltaic generation: The case of ontario, canada," *IEEE Trans. Sustain. Energy*, vol. 4, no. 3, pp. 680–688, Jul. 2013.
- [20] S. You, J. Guo, G. Kou, Y. Liu, and Y. Liu, "Oscillation mode identification based on wide-area ambient measurements using multivariate empirical mode decomposition," *Electric Power Syst. Res.*, vol. 134, pp. 158–166, May 2016.
- [21] S. You, J. Guo, W. Yao, S. Wang, Y. Liu, and Y. Liu, "Ring-down oscillation mode identification using multivariate empirical mode decomposition," in *Proc. Power Energy Soc. General Meeting (PESGM)*, Jul. 2016, pp. 1–5.
- [22] Y. Liu et al., "A distribution level wide area monitoring system for the electric power grid—FNET/GridEye," *IEEE Access*, vol. 5, pp. 2329–2338, 2017.
- [23] Y. Liu, S. You, and Y. Liu, "Smart transmission & wide area monitoring system," in *Communication, Control and Security for the Smart Grid*. NJ, USA: IET, 2017.
- [24] Y. Liu et al., "Recent developments of FNET/GridEye—A situational awareness tool for smart grid," *CSEE J. Power Energy Syst.*, vol. 2, no. 3, pp. 19–27, Sep. 2016.
- [25] *Phase 2 Report: DOE Draft—Part 1 Interregional Transmission Development and Analysis for Three Stakeholder Selected Scenarios*, Eastern Interconnection Planning Collaborative, Knoxville, TN, USA, 2013.
- [26] G. Kou et al., "Developing generic dynamic models for the 2030 eastern interconnection grid," in *Proc. IEEE PES T&D Conf. Expo.*, Apr. 2014, pp. 1–5.
- [27] S. You, Y. Liu, X. Zhang, G. Kou, Y. Liu, and S. Hadley, "Large-scale high PV power grid dynamic model development—A case study on the U.S. eastern interconnection," *IEEE Trans. Sustain. Energy*, to be published.
- [28] *Working Draft of MRN-NEEM Modeling Assumptions and Data Sources for EIPC Capacity Expansion Modeling*, Eastern Interconnection Planning Collaborative, Knoxville, TN, USA, 2010.
- [29] S. W. Hadley, *Additional EIPC Study Analysis: Interim Report on High Priority Topics*, Oak Ridge National Laboratory (ORNL), Oak Ridge, TN, USA, 2013.
- [30] *Working Draft of MRN-NEEM Modeling Assumptions and Data Sources for EIPC Capacity Expansion Modeling*, Charles River Associates, Boston, MA, USA, 2010.
- [31] Y. S. Baek et al., *Eastern Interconnection Demand Response Potential*, Oak Ridge National Laboratory (ORNL), Oak Ridge, TN, USA, 2012.
- [32] S. W. Hadley, D. J. Gotham, and R. L. Luciani, "Additional EIPC Study Analysis: Final Report," Oak Ridge Nat. Lab., Oak Ridge, TN, USA, Tech. Rep. RNUtm-20131447, 2014.
- [33] *HI 2015 North American PV Outlook*, Bloomberg New Energy Finance, New York, NY, USA, 2015.
- [34] United States Department of Agriculture, *Land Value 2015 Summary*, 2015.
- [35] K. Clark, R. A. Walling, and N. W. Miller, "Solar photovoltaic (PV) plant models in PSLF," in *Proc. IEEE Power Energy Soc. General Meeting*, Jul. 2011, pp. 1–5.
- [36] R. Altman and Y. Kazachkov, *PSS E modeling package for GE photovoltaic converters*, Siemens Energy, Inc., Erlangen, Germany, 2011.
- [37] M. L. Crow and A. Singh, "The matrix pencil for power system modal extraction," *IEEE Trans. Power Syst.*, vol. 20, no. 1, pp. 501–502, Feb. 2005.



SHUTANG YOU (S'13) received the B.S. and M.S. degrees in power engineering from Xi'an Jiaotong University, Xi'an, China, in 2011 and 2014, respectively. He is currently pursuing the Ph.D. degree at the Power IT Lab, The University of Tennessee, Knoxville, TN, USA. His research interests include power grid dynamics and synchronous measurement.



GEFEI KOU (S'14–M'17) received the B.S. degree from Tianjin University in 2011 and the M.S. and Ph.D. degrees in electrical engineering from The University of Tennessee, Knoxville, TN, USA, in 2014 and 2016. He is currently a Senior System Protection Engineer with Dominion Virginia Power. His research interests include power system dynamics and synchrophasors.



YONG LIU (S'10–M'15) received the B.S. and M.S. degrees in electrical engineering from Shandong University in 2007 and 2010, respectively, and the Ph.D. degree from The University of Tennessee, Knoxville, TN, USA, in 2013. He is currently a Research Assistant Professor with the Department of Electrical Engineering and Computer Science, The University of Tennessee, Knoxville. He is also a member of the DOE/NSF-cofunded Engineering Research Center CURENT.

His research interests include power system wide-area measurement, renewable energy integration, and power system dynamic modeling and analysis.



XUEMENG ZHANG (S'16) received the B.S. degree from Zhejiang University in 2015. She is currently pursuing the Ph.D. degree in electrical engineering at The University of Tennessee, Knoxville, TN, USA. Her research interests include the impact of renewable energy generation such as wind and PV on bulk power grid frequency response, the advanced renewable generation active power control for frequency response improvement, and measurement-based power system model reduction techniques.



YI CUI (S'12–M'16) received the B.Sc. (Engg.) and M.Sc. (Engg.) degrees in electrical engineering from Southwest Jiaotong University, Chengdu, China, in 2009 and 2012, respectively, and the Ph.D. degree from The University of Queensland, Brisbane, Australia, in 2016. He is currently a Research Associate with the Power IT Lab, The University of Tennessee, Knoxville, TN, USA. His research interests include power system oscillation, power transformers condition assessment, and fault diagnosis.



WENXUAN YAO (S'14) received the B.S. degree in electrical engineering from Hunan University, Changsha, China, in 2011, where he is currently pursuing the Ph.D. degree. He is also pursuing the Ph.D. degree at the Department of Electrical Engineering and Computer Science, The University of Tennessee, Knoxville, TN, USA. His research interests are wide-area power system measurement and digital signal process.



MICAH J. TILL (S'13) received the B.S.E.E. degree from Tennessee Technological University, Cookeville, TN, USA, in 2011. He is currently pursuing the Ph.D. at the Department of Electrical Engineering and Computer Science, The University of Tennessee, Knoxville, TN, USA.



YILU LIU (S'88–M'89–SM'99–F'04) received the M.S. and Ph.D. degrees from The Ohio State University, Columbus, OH, USA, in 1986 and 1989, respectively. She was a Professor with Virginia Tech. She led the effort to create the North American power grid Frequency Monitoring Network at Virginia Tech, which is currently operated at The University of Tennessee, Knoxville, (UTK), TN, USA, and the Oak Ridge National Laboratory (ORNL) as GridEye. She is currently the Governor's Chair with UTK and ORNL. Her current research interests include power system wide-area monitoring and control, large interconnection-level dynamic simulations, electromagnetic transient analysis, and power transformer modeling and diagnosis. She is a member of the U.S. National Academy of Engineering.

• • •